


Installation Guide

Service thermostats
Type **077Z**





077R0704

Service thermostats 077Z7010

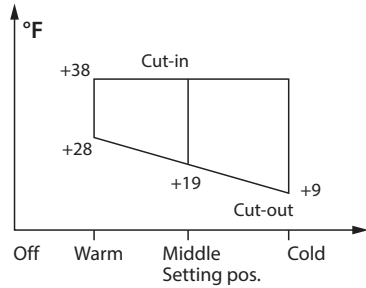


16 - 96 A
EBD

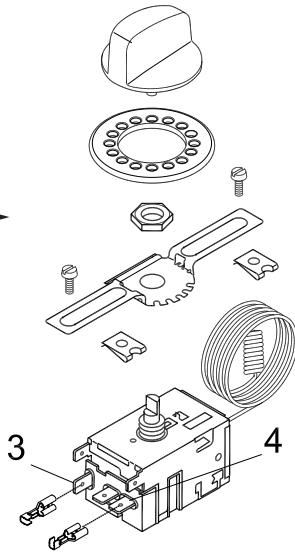



Length of capillary (in): L = 39
(airsensor)

Service thermostats 077Z7011

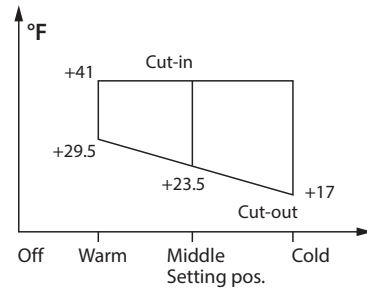


16 - 96 A
EBD

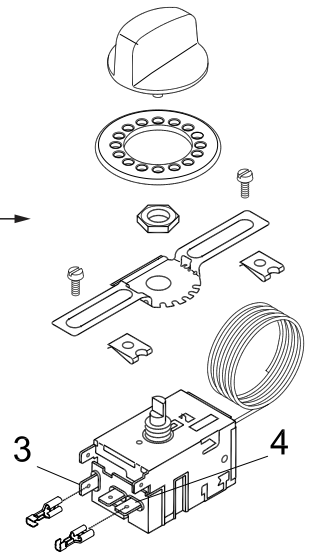



Length of capillary (in): L = 84
Min. sensor length mounted on evaporator (in):
LS = 6
(Used as airsensor min. 2 x LS)

077R0704

Service thermostats 077Z7012

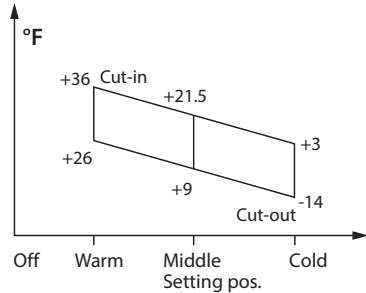


16 - 96 A
EBD

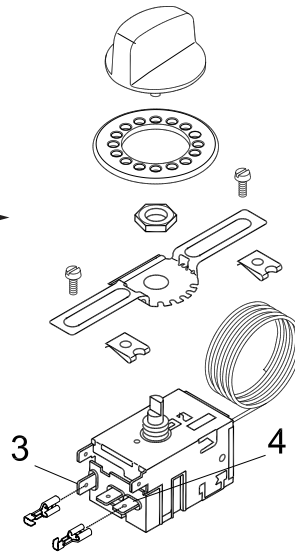



Length of capillary (in): L = 42
Min. sensor length mounted on evaporator (in):
LS = 4
(Used as airsensor min. 2 x LS)

Service thermostats 077Z7013

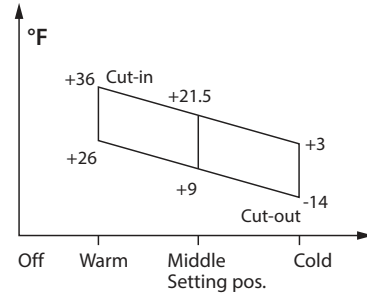

16 - 96 A
EBD

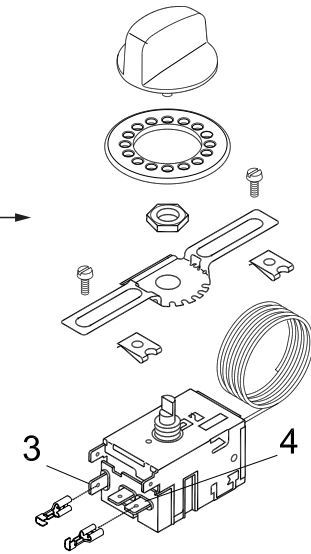


Length of capillary (in): L = 84
Min. sensor length mounted on evaporator (in):
LS = 6
(Used as airsensor min. 2 x LS)



Імпортер: ТОВ з іл "Данфосс ТОВ" 04080, Київ 80, п/с 168, Україна

Info for UK customers only: Danfoss Ltd., 22 Wymcombe End, HP9 1NB, GB

Service thermostats 077Z7014

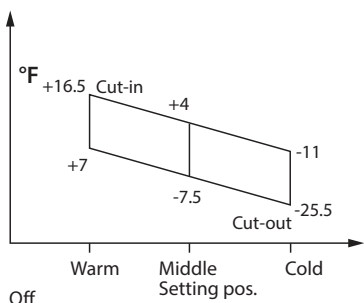


16 – 96 A
EBD

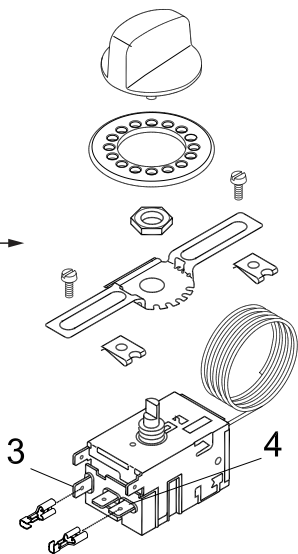



Length of capillary (in): L = 84
Min. sensor length mounted on evaporator (in): LS = 5
(Used as airtensor min. 2 x LS)

Service thermostats 077Z7015

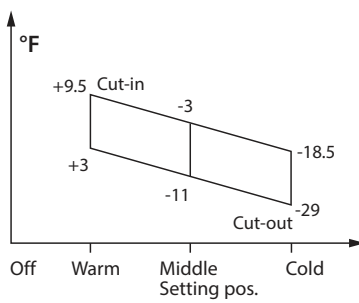


16 – 96 A
EBD

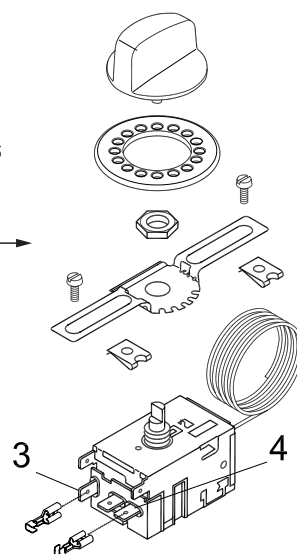



Length of capillary (in): L = 42
Min. sensor length mounted on evaporator (in): LS = 4
(Used as airtensor min. 2 x LS)

Service thermostats 077Z7016

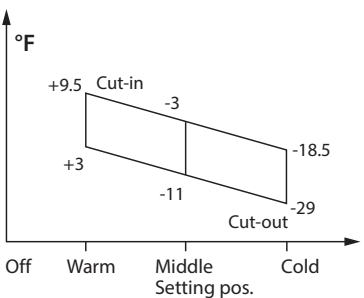


16 – 96 A
EBD

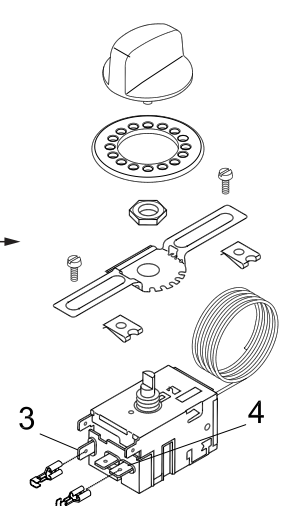



Length of capillary (in): L = 84
Min. sensor length mounted on evaporator (in): LS = 5
(Used as airtensor min. 2 x LS)

Service thermostats 077Z7017

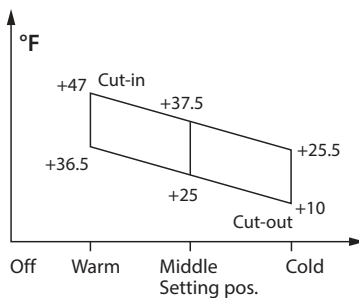

16 – 96 A
EBD

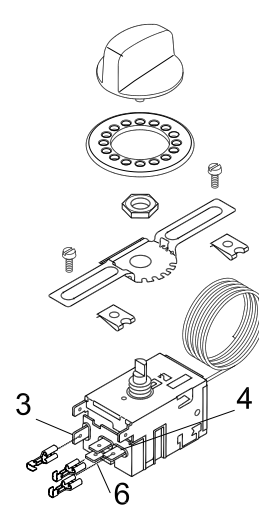

Length of capillary (in): L = 66
Min. sensor length mounted on evaporator (in): LS = 4
(Used as airtensor min. 2 x LS)



The 077Z...EBD, 077Z...L EBD can be applied on systems with R290 and R600a as the working fluid. Always adhere to local codes and safety guidelines. For countries with no conformity certification (UL, CE, CCC, CSA, EAC, etc.) requirements on new systems, Danfoss recommends third party approval for systems containing flammable refrigerants.

Note: All temperatures at 760 mm Hg

Danfoss A/S

Climate Solutions • danfoss.com • +45 7488 2222

Any information, including, but not limited to information on selection of product, its application or use, product design, weight, dimensions, capacity or any other technical data in product manuals, catalogues descriptions, advertisements, etc. and whether made available in writing, orally, electronically, online or via download, shall be considered informative, and is only binding if and to the extent, explicit reference is made in a quotation or order confirmation. Danfoss cannot accept any responsibility for possible errors in catalogues, brochures, videos and other material. Danfoss reserves the right to alter its products without notice. This also applies to products ordered but not delivered provided that such alterations can be made without changes to form, fit or function of the product.

All trademarks in this material are property of Danfoss A/S or Danfoss group companies. Danfoss and the Danfoss logo are trademarks of Danfoss A/S. All rights reserved.